



Town of Lisbon

Culvert Installation Guidelines

- Town Engineer Jahnke & Jahnke Associates Inc. **must be notified 48 hours in advance of installation** to schedule inspection (262-542-5797).
- Town Representative (Engineer) **must be on site during installation of culvert.**

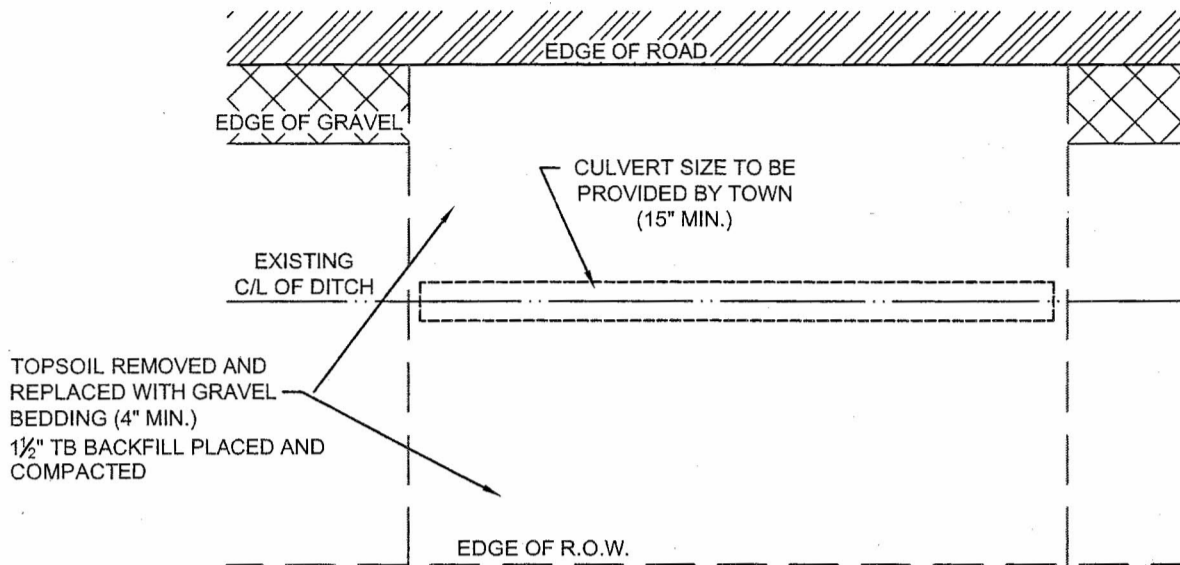

PLAN VIEW

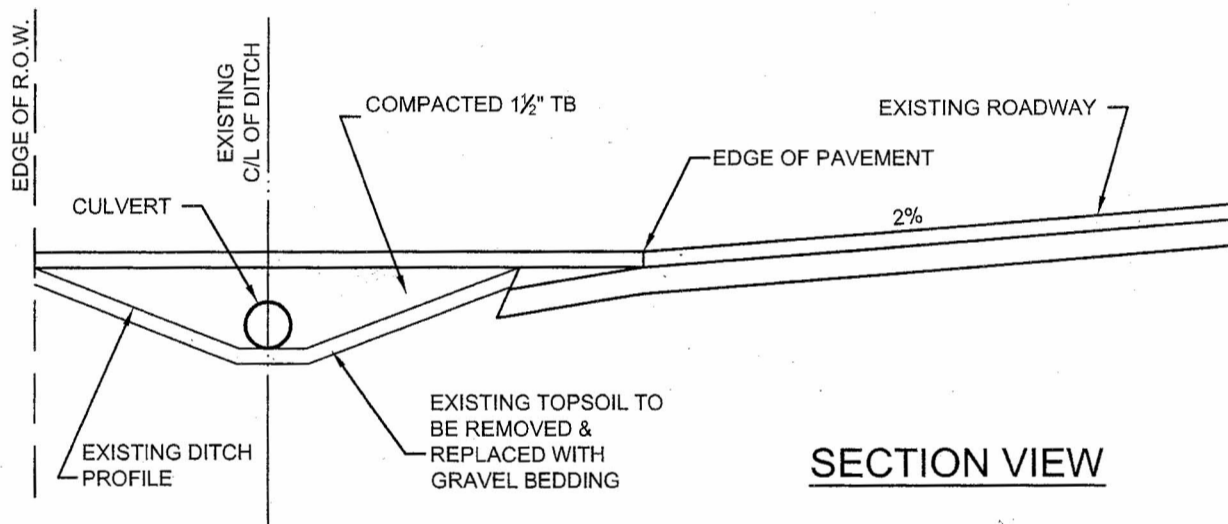

SECTION VIEW

- Topsoil to be removed throughout ditch from edge of Right-of-Way (ROW) to edge of road.
- Backfill to consist of 1 ½" Limestone T.B., compacted in lifts (12" max.).
- Corrugated Metal Pipe (CMP) Culvert to be 16 Gauge galvanized steel (min. length 22' max. length 30').
- Culvert to be greater than 5' from nearest property line.
- Culvert size to be provided by Town (Min. 15").
- Any culvert 21" or larger shall be arched pipe.